

Digital Audio VR Systems CABLE SUPPLEMENT

1-6 Entrances Zone isolation (DBA-8Z) Flat distribution at floor level with PSU

PD-336 Issue 1


Note

1. Contact Technical support for more than 1 phone per flat.
2. Maximum of 300m between the furthest 2 point
3. All control equipment must be located in protected indoor areas.
4. Allow extra cabling for any Fob readers, Fob/Proximity system, third party equipment, and spare cores.

Control Equipment Used

DBA-8Z Zonal Isolator/Distributor for 8 flats
BFD-DIG Digital Door Controller
TS2000-BST Time Clock
PS4 Power Supply, 13.8VDC, 4A
340C Power Supply, 13.8VDC, 1.5A


Cable legends

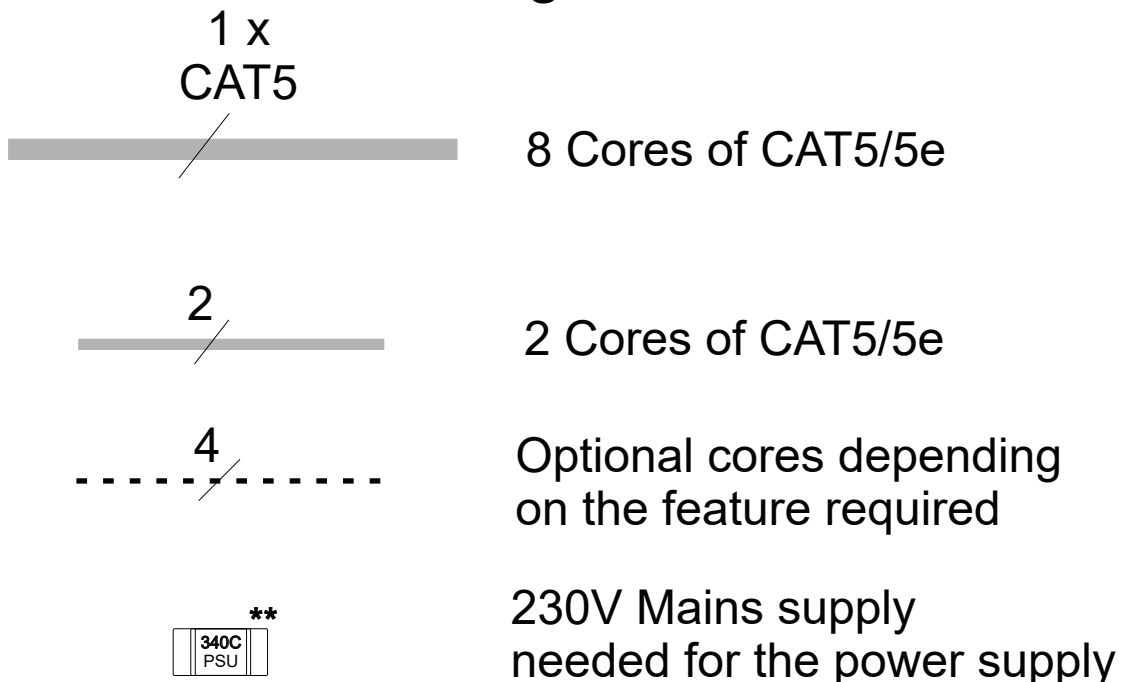

Part 1

Entrances 3-6

(optional)

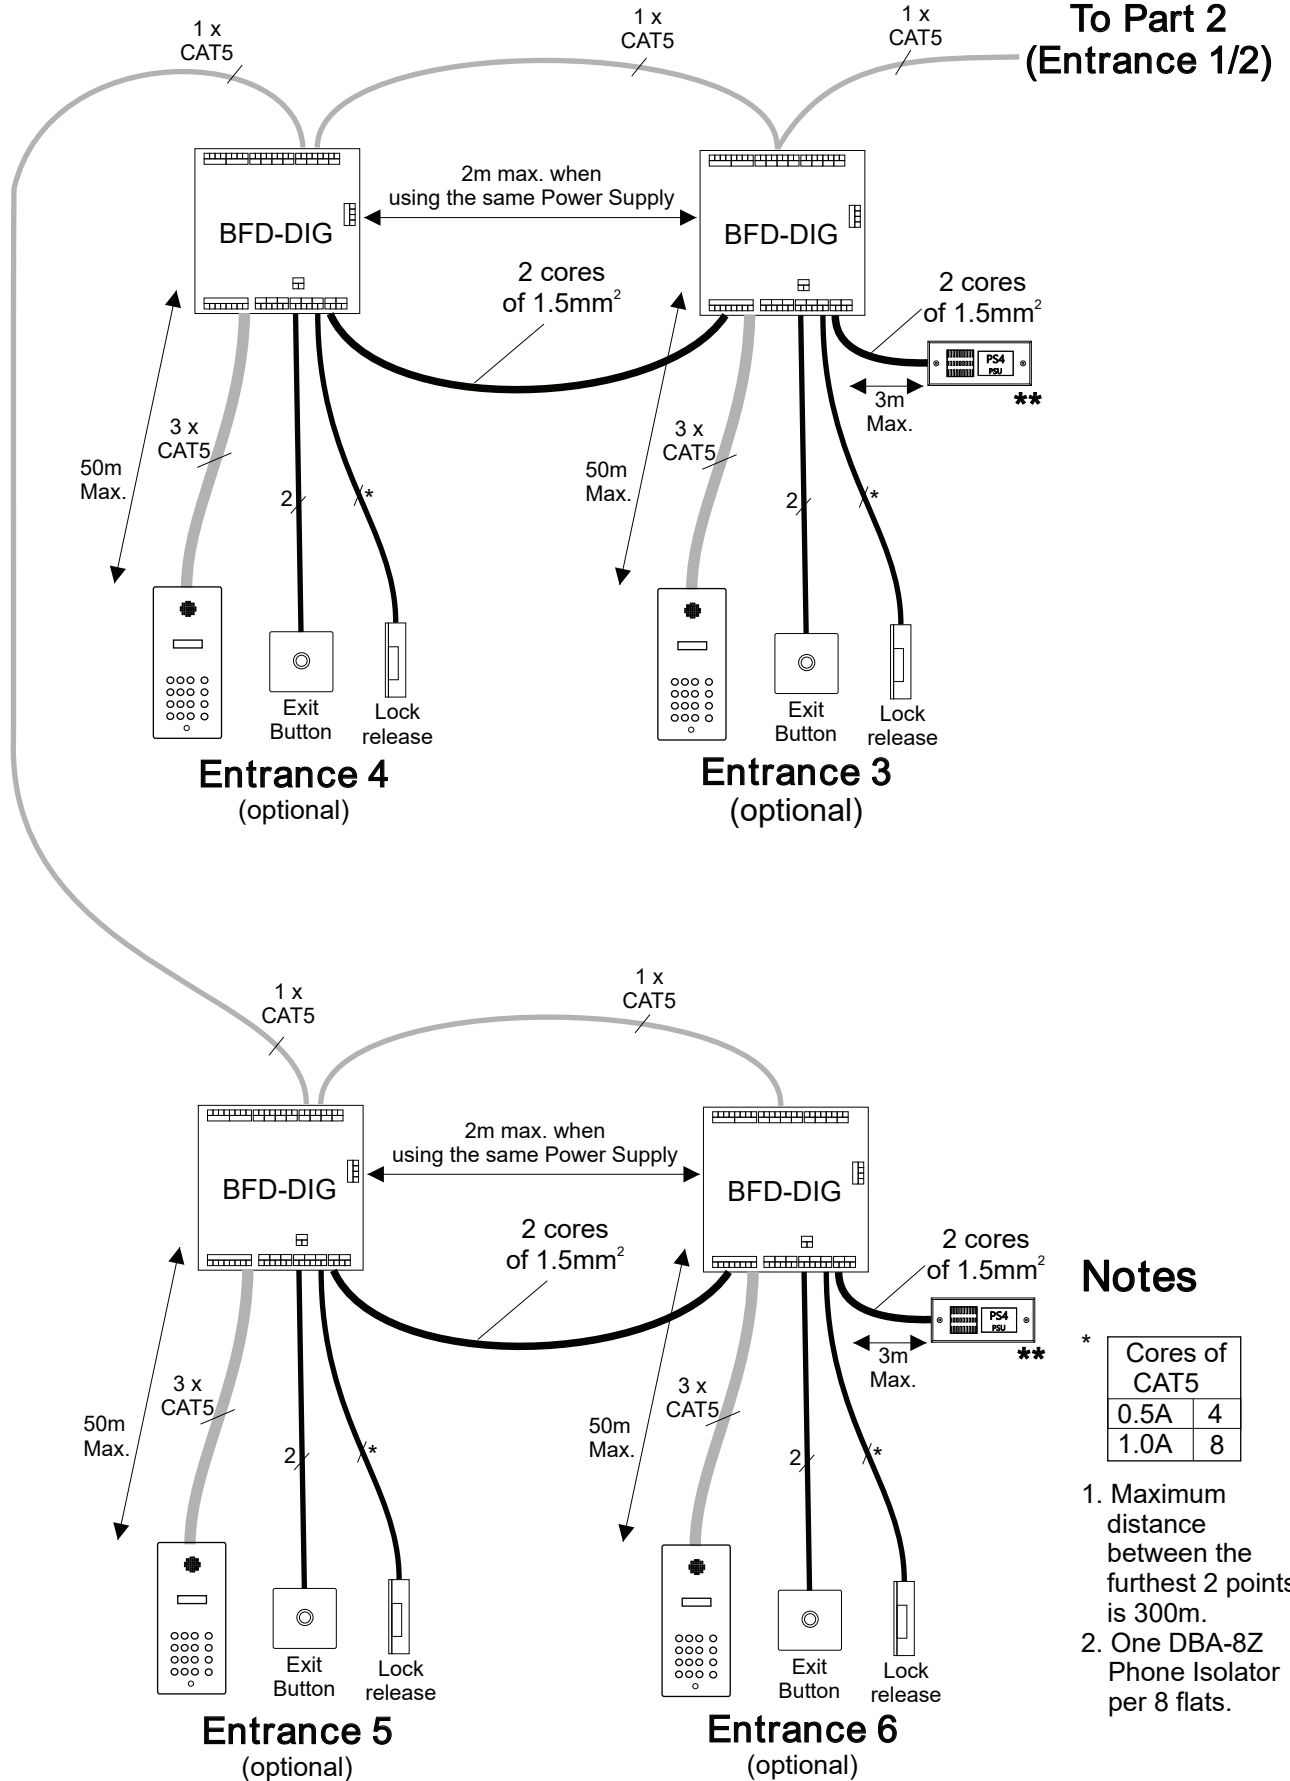


Notes

*


Cores of CAT5	
0.5A	4
1.0A	8




1. Maximum distance between the furthest 2 points is 300m.
2. One DBA-8Z Phone Isolator per 8 flats.

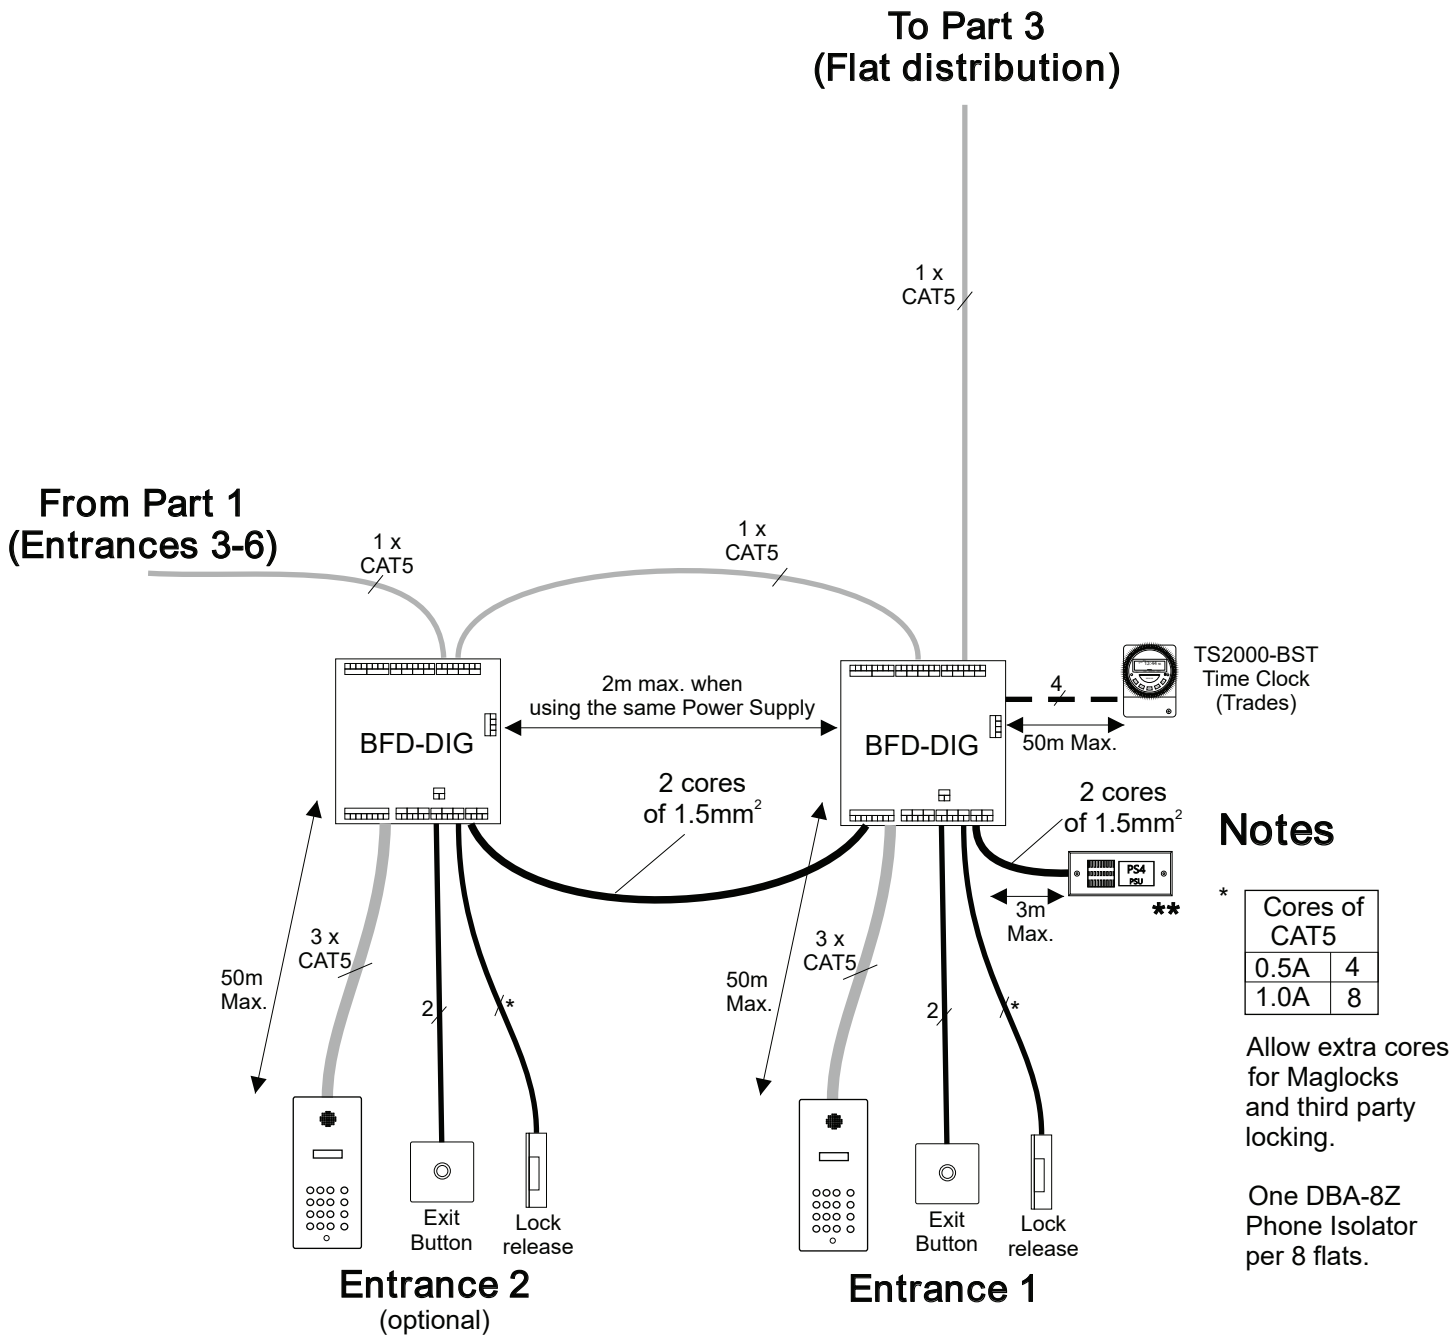Part 2 Entrances 1 and 2

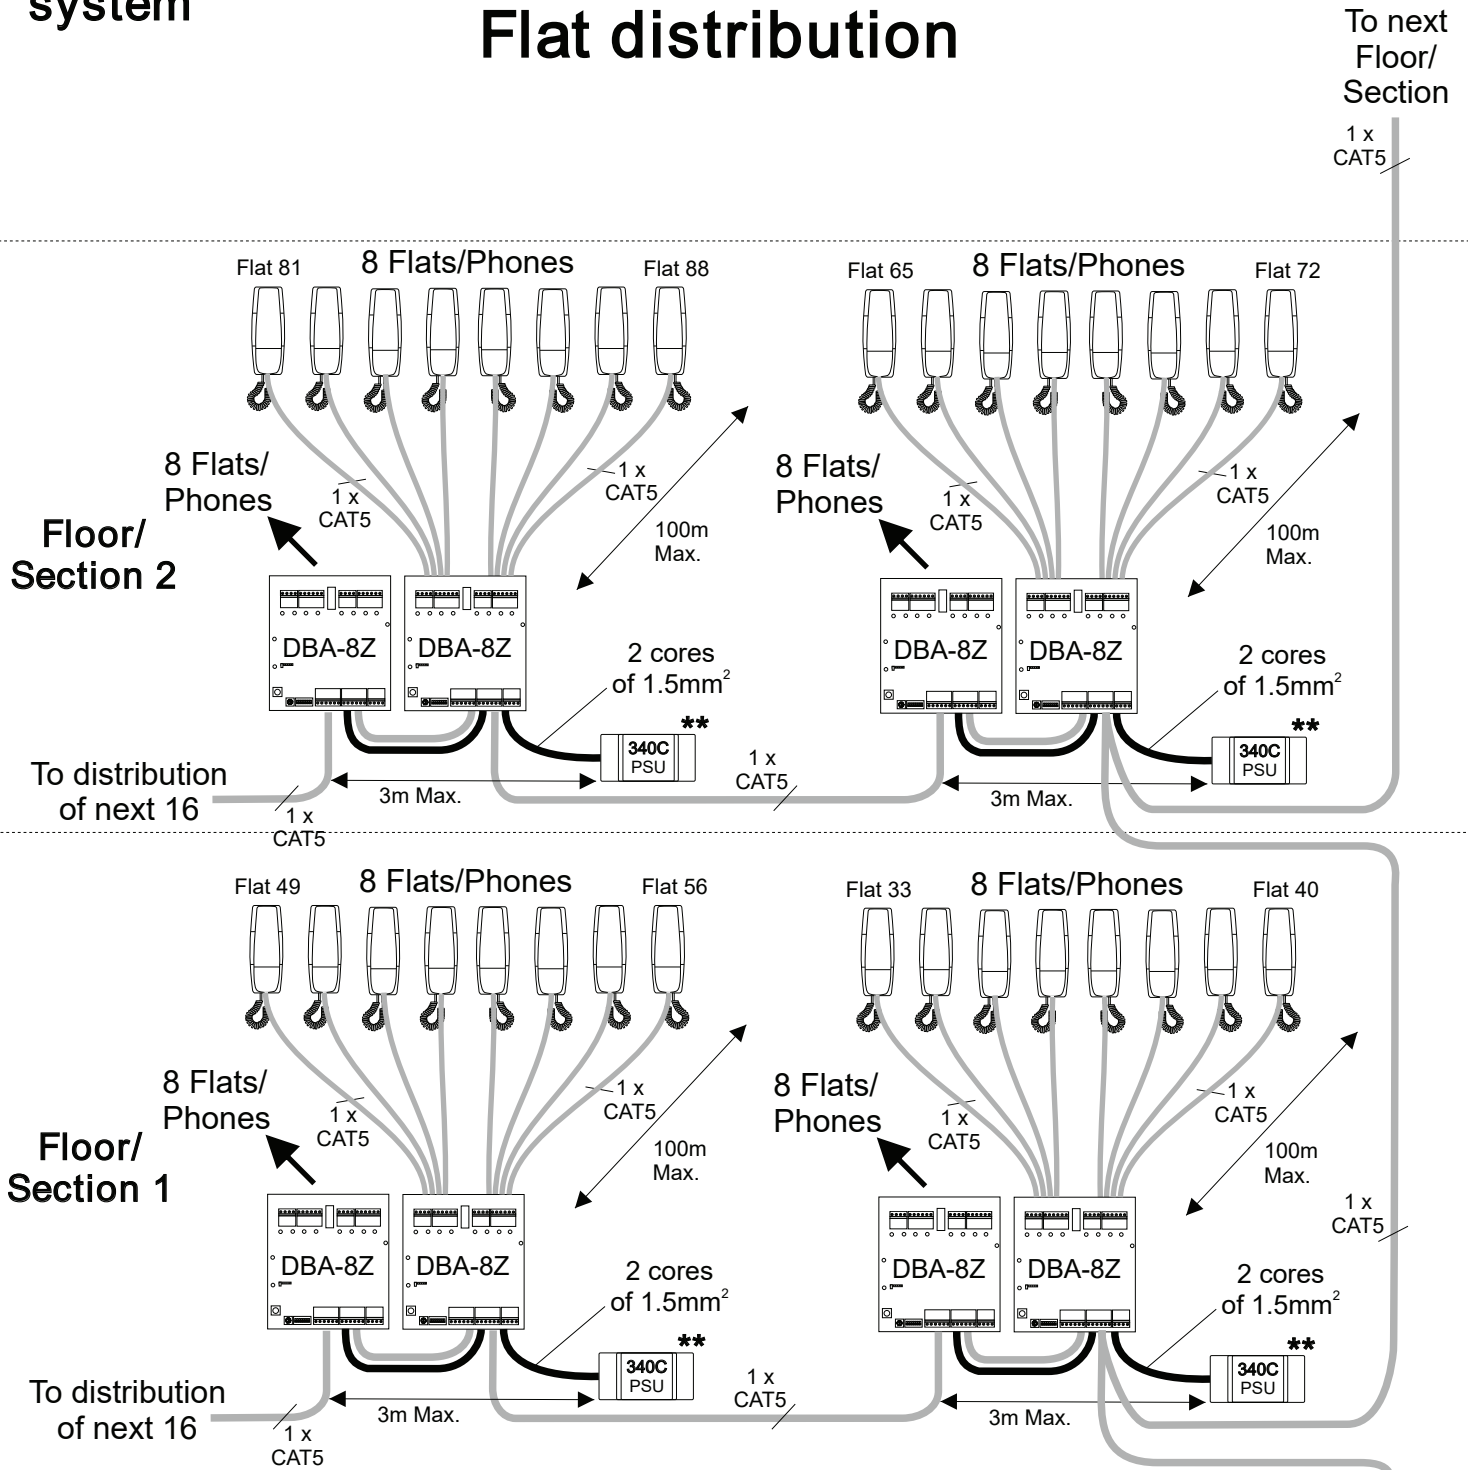

Part 3 Flat distribution



Phone model			
	801 801P	XL5-PS	XL5-LX
No. of cores required	5	5	7